

Lordshill Library
Review Photographs
30th August 2018



Cleaners Room Water Heater

The cleaners room water heater was found to have a good storage temperature at the time of this 2018 review; I was informed this heater and the cold water outlet on the sink are not used and should therefore be flushed at least on a weekly basis; this is not being carried out.




Kitchen Water Heater

The kitchen water heater was found to have a good storage temperature at the time of this 2018 review.



Toilet Water Heaters

The instantaneous type water heaters are located in both toilet areas; both produced above 50.0C at the outlets at the time of this review.

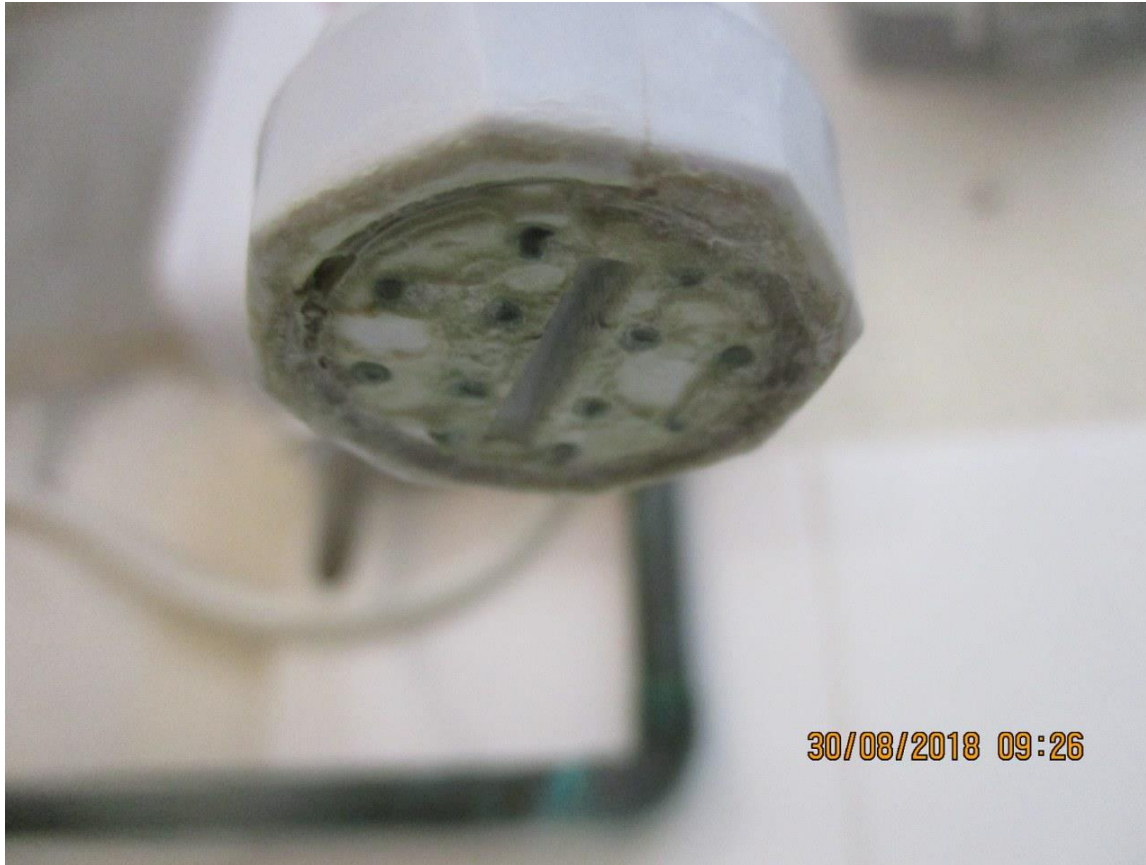

Scale Build Up

Ensure all water heater outlet spouts and tap outlets are maintained in a good scale free condition; scale can act as a nutrient for the proliferation of bacteria.



Deadleg Area

The cleaners room water heater and cold water outlet are not being used thus creating a deadleg area; these outlets should therefore be flushed through at least on a weekly basis.