

LEGIONELLA RISK ASSESSMENT

For

**Sholing Community Centre
Butts Road
Southampton
SO19 1BQ**

Prepared By

Peter Smith MWM Soc.
Risk Assessor
Freston Water Treatment Ltd
Unit 1 Lulworth Business Centre
Nutwood Way
Calmore Industrial Estate, Totton
Southampton SO40 3WW

10th June 2019



Sholing Community Centre

CONTENTS

PREFACE	Page 3
INTRODUCTION & LEGIONELLA CONTROL	Pages 4 - 13
SITE SURVEY COLD & HOT DISTRIBUTION	Pages 14 - 18
WATER DISTRIBUTION & TEMPERATURES	Pages 19 - 20
SHOWERS & ASSET REGISTER	Pages 21 - 22
GENERAL, ADDITIONAL PHOTOGRAPHS, EMERGENCY PROCEDURES, DRAWINGS & RECORDS	Pages 23 - 30
CONTROL MEASURES, SUMMARY & REMEDIAL RECOMMENDATIONS	Pages 31 - 39
GLOSSARY OF TERMS	Pages 40 - 44
TERMS AND CONDITIONS	Page 45
LEGISLATION	Pages 46 - 47

PREFACE

Customer: Southampton City Council

Customer Address: Regional Business Centre
1 Guildhall Square
Southampton
SO14 7FP

Customer Contact: Lisa Huntriss
Telephone: 07500994004

Site Address: Butts Road
Southampton
SO19 1BQ

Site Contact: Jenny Roles
Site Telephone: 0238399979

Freeston Water Treatment Address:
Unit 1
Lulworth Business Centre
Nutwood Way
Calmore Industrial Estate
Totton
Southampton
SO40 3WW

Telephone: 02380 669713
Fax: 02380 663825

Risk Assessment Consultant: Peter Smith MWM Society

Date of Assessment: 10th June 2019
Date of Review June 2021

INTRODUCTION and LEGIONELLA CONTROL

This report relates to a Legionella Risk Assessment carried out by Peter Smith of Freeston Water Treatment Ltd on the 10th June 2019 on behalf of Southampton City Council. The survey was carried out at Sholing Community Centre, Butts Road, Southampton SO19 1BQ. During the course of the survey the water systems within the centre were risk assessed; these systems were chosen as being fully representative of the water systems within the building.

The survey and risk assessment were undertaken in order to comply with the Health and Safety Executive requirements on the control and prevention of Legionellosis. The risk assessment has been carried out in accordance with ACoP L8:2013 - The control of Legionella bacteria in water systems (Approved Code of Practice and Guidance on Regulations), HSG274:2013 Legionnaires Disease: Technical Guidance and BS8580 Water Quality – Risk Assessments for Legionella Control – Code of Practice.

The survey has been limited to the terms of reference agreed between Southampton City Council and Freeston Water Treatment Ltd. Observations relating to system conditions and other factors applicable to the requirements of ACoP L8 and HSG274 have been recorded during the survey and specific references are made to compliance with the ACoP and the Technical Guidance in the Observations section of the report.

A Summary of Recommendations concludes the report. ACoP L8:2013 and HSG274 place responsibility on employers and others to prepare a scheme for preventing or controlling the risk from Legionellosis. Adoption of a monitoring scheme in conjunction with a regime of preventative maintenance and associated record keeping will meet these requirements.

Legionella Bacteria

- Legionellaceae are common environmental bacteria found in most natural water resources, including lakes and rivers. They can also survive water treatment processes in small numbers and can occur within mains water. Should these bacteria then enter any water service where they can multiply, and where a means of creating and transmitting water droplets is present, people using or in the vicinity of these services may be at risk.
- Infections caused by Legionella pneumophila bacteria or other organisms within the family Legionellaceae are termed Legionellosis. Legionnaires' disease is the worst of these and causes a pneumonia which can be fatal. Those most at risk are the very old and very young, the immunosuppressed and smokers etc.
- Legionella bacteria can also cause other, less harmful illnesses such as Pontiac fever and Lochgoilhead fever, which can affect all people.

The primary route of infection is caused by inhaling airborne water droplets that contain Legionella and are small enough to pass deep into the lung. It is also now believed that the disease can be contracted by inhaling Legionella bacteria following:

- Ingestion of contaminated water by susceptible individuals. It cannot be spread from person to person.
- The majority of individual cases or outbreaks of disease have been attributed to domestic water services within buildings, evaporative cooling towers and whirlpool spas, etc.

Legionnaire's disease is most commonly caused by the inhalation of water droplets contaminated with the Legionella bacteria. It is therefore important that systems susceptible to colonisation by Legionella and which incorporate a potential means for creating and disseminating water droplets should be identified and the risk they present assessed.

A number of factors are required to create a risk of Legionellosis:-

- The presence of Legionella bacteria.
- Conditions suitable for the proliferation of those bacteria.
- A means of creating and disseminating an aerosol.
- The presence of individuals who may be exposed.

The conditions favouring the proliferation of Legionella are: -

- Moisture
- Temperature between 20.0°C and 45.0°C
- Availability of nutrients, for example, from sediment, sludge, organic material, scale, rust, compatible organisms and materials used in construction of water systems
- Presence of biofilm (bacterial slime) on surfaces in contact with water

The elimination of as many of these conditions as possible forms the basis of control of the risk. Treatment regimes to eradicate or reduce the proliferation of Legionella (based on physical or chemical disinfection of water systems) also help to control the risk but do not prevent it.

Under the ACoP, a suitable and sufficient assessment is required to identify and assess the risk of exposure to Legionella bacteria from work activities and water systems on the premises and any necessary precautionary measures.

Management Control

The Health and Safety Executive (HSE) highlights that poor management control and lack of record keeping can be major factors contributing to the inadequate control of Legionella bacteria. At all times there should be a documented Statutory Duty Holder, Responsible Person, Deputies and a suitable communication pathway list.

All personnel involved with Legionella management should be suitably trained and competent. Refresher training should be undertaken as required.

A Written Scheme is required to be prepared to ensure that all necessary controls and procedures are maintained, monitored and remain effective. BS8580 states – ‘Note- the Risk Assessment does not involve the preparation of the written scheme but rather provides information that is critical to the preparation’.

Regulations and guidance regarding the Written Scheme can be found in ACoP L8 Paragraphs 58-64.

The assessment is carried out by or on behalf of Southampton City Council.

- The employer, where the risk from their undertaking is to their employees or to other; or
- A self-employed person, where there is a risk from their undertaking to themselves or to others; or
- The person who is in control of the premises or systems in connection with the work where the risk is present from systems in the building (e.g. Tenants where the building is let. However, the landlord retains responsibility for its maintenance).

The assessment needs to be reviewed regularly and, in any case, whenever there is reason to believe that the original assessment may no longer be valid.

L8:2013 - The control of Legionella bacteria in water systems (Approved Code of Practice and Guidance on regulations), which was published by the Health and Safety Executive, highlights at paragraph 49 the importance of using competent service providers, it states;

“Those appointed to carry out the risk assessment and draw up and implement precautionary measures should have such ability, experience, instruction, training and resources to enable them to carry out their tasks competently and safely”.

Then at paragraph 57 it states;

“Dutyholders should make reasonable enquiries to satisfy themselves of the competence of contractors in the area of work”

Paragraph 57 further states:

“An illustration of the levels of service to expect from Service Providers can be found in the Code of Conduct administered by the Legionella Control Association”

Freeston Water Treatment Ltd is registered with The Legionella Control Association (LCA). To be registered with the LCA a service provider has to agree to meet nine key service provider commitments and they are required each year, as evidence that they meet these commitments, to submit to the LCA secretariat an up to date statement of compliance. The statement should explain how the registering company complies with the nine commitments in terms of the Legionella control services that it provides.

Other Important Information

HSG274 Part 2 makes specific comments and recommendations regarding Thermostatic Mixing Valves – please note the extracts below: -

Section 2.74

TMVs are valves that use a temperature sensitive element and blend hot and cold water to produce water at a temperature that safeguards against the risk of scalding, typically between 38.0°C and 46.0°C depending on outlet use. The blended water downstream of TMVs may provide an environment in which legionella can multiply, thus increasing the risks of exposure.

Section 2.75

The use and fitting of TMVs should be informed by a comparative assessment of scalding risk versus the risk of infection from legionella. Where a risk assessment identifies the risk of scalding is insignificant, TMVs are not required.

The most serious risk of scalding is where there is whole body immersion, such as with baths and showers, particularly for the very young and elderly, and TMVs should be fitted at these outlets. Where a risk assessment identifies a significant scalding risk is present, e.g. where there are very young, very elderly, infirm or significantly mentally or physically disabled people or those with sensory loss, fitting TMVs at appropriate outlets, such as hand washbasins and sinks, is required.

The above recommendations mean that consideration should be given to removing TMVs where a scalding risk (as outlined above) is not significant. Where hot water temperatures are likely to be elevated it would be advisable to affix a Hot Water warning sign adjacent to the outlet.

Periodic Review

Risk assessments should be reviewed when: -

- Significant changes have been made to a system, e.g. remedial works or planned modifications have been implemented. The assessment must be completed for routine system operation and also for circumstances such as breakdown, abnormal operation, commissioning, or other unusual circumstances.
- Changes have been made to the management and/or maintenance of the system, e.g. 6 months after a new maintenance company has been appointed.
- Significant changes have occurred in the way a system is being used, e.g. a formerly fully occupied building is now only partially occupied. If there is a doubt about what circumstances should initiate a review of the risk assessment, particularly at a complex or developing site, then a programme of annual reviews of audits should be considered.
- The availability of new information about risks or control measures.
- The results of checks indicating control measures are no longer effective.
- A case of Legionnaires disease/Legionellosis associated with the system.

HOWEVER, IT IS OUR RECOMMENDATION THAT A REVIEW SHOULD BE CARRIED OUT AT A MINIMUM FREQUENCY OF EVERY TWO YEARS.

The risk assessment report relates to observations made and information supplied at the time of the survey. Every effort has been made to examine as much of the domestic water system as possible although some areas, such as pipework beneath floors or behind walls, would not have been inspected due to restricted access.

SITE SURVEY

The following section contains the condition survey reports for all water systems and associated plant located within the buildings premises. This includes where fitted:

- Cold Water Storage Tanks
- Calorifiers / Hot Water Cylinders
- Local Water Heaters <15 litres
- Local Water Heaters > 15 litres
- Showers
- Water Softeners
- Hot and Cold-Water Distribution Temperatures
- Any Other Water Systems

Any points of note or results that are out of parameter are highlighted in red.

System Reference	Domestic Water Systems
Location	Sholing Community Centre
Method	Visual Assessment and Temperature Profiling

Management Control

The Health & Safety Executive (HSE) highlights that poor management control and lack of record keeping can be major factors contributing to the inadequate control of Legionella bacteria. At all times there should be a documented responsible person and a suitable communication pathway list. All personnel involved with Legionella management should be suitably trained.

At the time of this assessment there was seen to be a Southampton City Council water systems logbook in place for the buildings water systems; the logbook was seen filed in the metal cabinet in the main hall area; the duty holder, responsible person and deputies were seen recorded in section two of the logbook documentation at the time of this assessment.

Monthly Legionella control monitoring for the community centre is being carried out by contractors Freeston Water Treatment Ltd; this was seen to be up to date as of May 2019. No records were seen for weekly flushing of infrequently used outlets within the logbook documentation.

COLD WATER STORAGE

There is no cold-water storage within Sholing Community Centre all cold water is supplied directly from the mains water services which appears to rise at in the store room area at the back of the stage to the rear of the building. It was noticed that the mains water isolating valve if it had to be shut of quickly could not be access due to the amount of stored items in this area; I would recommend access to this isolating valve be made clear.

HOT WATER STORAGE

Hot water within the community centre is by local water heaters supplied directly from the mains water services; these are small capacity local water heaters located in the toilet and kitchen areas. It was noted that the water heaters in the toilet areas were all switched off; I was informed these water heaters are not being used thus creating deadleg areas. If the water heaters are not required then consideration should be given into their removal along with all associated pipe work; if they are to remain then a flushing regime should be put in place and all water heaters should be flushed through at least on a weekly basis.

The storage temperature taken from the main kitchen water heater at the time of this assessment was found to be satisfactory. It is recommended in the ACoP L8 and HSG 274 part 2 that water heaters with no greater than 15 litres capacity should operate at 50.0°C – 60.0°C.

HOT WATER STORAGE PHOTOGRAPHS

P1

Local water heater serving the front kitchen area; good storage temperature recorded at the time of this assessment.



P2

Typical water heater located in the toilet areas; all switched off at the time of this assessment thus creating deadleg pipe work; if not used open and flush through all heaters at least on a weekly basis and record when carried out. If switched on ensure water heater operates at 50.0°C – 60.0°C.



DOMESTIC WATER DISTRIBUTION

Domestic water systems are very susceptible to colonisation by Legionella bacteria where favourable conditions occur. Poorly designed, inadequately maintained systems, or those that operate at unsuitable temperatures, can aid the rapid multiplication of bacteria such as Legionella within these services.

Any water system achieving temperatures within the band 20.0°C to 45.0°C may allow the establishment and proliferation of Legionella bacteria. These conditions may occur within hot water services, including calorifiers or heaters, in "deadlegs", intermittently used water services, or indeed cold-water services where due to insufficient lagging, over-capacity and/or stagnation, warming occurs.

The direct risk comes from the generation of aerosols (fine water droplets). This may happen from any water outlet within the premises although the risk is low from non-spray outlets. Where showers, spray taps etc. are installed within the building water services, the risk is increased.

Mains cold water within the community centre rises within the store room area at the rear of the stage; the mains water serves all cold-water outlets, toilet and urinal flush, outside tap, roof void F&E tank and all local water heaters.

Hot water storage within the community centre is from local water heaters located in the front kitchen and in all toilet areas; serving these areas only.

In all areas of distribution and use, inspection, test and measurement was undertaken at representative positions in order to evaluate conditions and areas of potential risk.

At the time of the survey (within one minute) for hot water and (within two minutes) for cold water outlets in the buildings were recorded as follows:-

Location	Temperature °C			Comments
	Hot	Cold	Mixed	
Front kitchen	56.3	13.6		Satisfactory
Gents WC	No Hot	16.0		Not Satisfactory
Accessible WC	No Hot	16.2		Not Satisfactory

As already mentioned, the local water heaters in the toilet areas appear to be permanently switched off; thus, creating deadleg areas. I would recommend consideration be given into the removal of water heaters if not required along with all associated pipe work or at least flush through at least on a weekly basis and record when carried out.

SHOWERS

There were no showers fitted in the community centre at the time of this assessment.

ASSET REGISTER

Domestic Water Asset Register		
Floor Level	Area	Asset Type
Ground Floor	Front kitchen	1 x Sink 1 x Water Heater 1 x Dishwasher 1 x Outside Tap <i>Sentinel nearest hot furthest cold.</i>
Ground Floor	Ladies Toilet	1 x Wash Basin 2 x WC 1 x Water Heater <i>Sentinel nearest hot nearest cold</i>
Ground Floor	Gents Toilet	1 x Wash Basin 1 x WC 3 x Urinals 1 x Water Heater <i>Sentinel nearest hot</i>
Ground Floor	Accessible Toilet	1 x Wash Basin 1 x WC 1 x Water Heater <i>Sentinel nearest hot</i>
Ground Floor	Rear Kitchen	1 x Sink
Ground Floor	Ceiling Void	1 x F&E Tank

GENERAL

- Deadleg pipe work is an ideal area for bacteria proliferation and should be removed or flushed without creating an aerosol at least on a weekly basis and recorded when carried out. Deadleg pipe work was seen in the following areas: -
 - DL1 - There is a small deadleg in the basement area at height where the mains water pipe work has been capped off; recommend removal.
 - DL2 – There is deadleg pipe work where the local water heaters in all toilet areas are not being used; recommend removal or flush through at least on a weekly basis and record when carried out.
 - DL3 - There is deadleg pipe work where the rear kitchen sink is not being used; recommend removal or flush through at least on a weekly basis and record when carried out.
- Ensure all tap outlets within the community centre are kept free of scale build up as this is an ideal nutrient for bacteria proliferation; clean on a regular basis.
- Ensure any infrequently used outlets within and external to the community centre are flushed through at least on a weekly basis; record when carried out in the water systems logbook.
- Ensure all flexile pipe fittings within the community centre are WRAS approved as ideal areas for bacteria proliferation; when kinked they will break down internally.

- The old toilet areas at the rear of the stage are no longer in use and have been disconnected from the live water services; I was informed that pungent smells come from the sewage waste pipe work in these old toilet areas; I would recommend these old toilet and outlets be removed along with all sewage waste pipe work.
- There was seen to be no insulation fitted to the mains water pipe work within the community centre or ceiling voids; I would recommend insulation be fitted to help prevent possible elevated cold-water temperatures especially in the summer months.
- It was noticed that the mains water isolating valve if it had to be shut of quickly could not be accessed due to the amount of stored items in this area; I would recommend access to this isolating valve be made clear.

ADDITIONAL PHOTOGRAPHS

P3

DL1 - There is a small deadleg in the basement area at height where the mains water pipe work has been capped off; recommend removal.



P4

DL2 – There is deadleg pipe work where the local water heaters in all toilet areas are not being used; recommend removal or flush through at least on a weekly basis and record when carried out.



P5

DL3 - There is deadleg pipe work where the rear kitchen sink is not being used; recommend removal or flush through at least on a weekly basis and record when carried out.



P6

Ensure all tap outlets within the community centre are kept free of scale build up as this is an ideal nutrient for bacteria proliferation; clean on a regular basis.



P7

Ensure any infrequently used outlets within and external to the community centre are flushed through at least on a weekly basis; record when carried out in the water systems logbook.



P8

Ensure all flexile pipe fittings within the community centre are WRAS approved as ideal areas for bacteria proliferation; when kinked they will break down internally.



P9

There was seen to be no insulation fitted to the mains water pipe work within the community centre or ceiling voids; I would recommend insulation be fitted to help prevent possible elevated cold-water temperatures especially in the summer months.



P10

It was noticed that the mains water isolating valve if it had to be shut off quickly could not be accessed due to the amount of stored items in this area; I would recommend access to this isolating valve be made clear.



P11


Although these areas are disconnected from the live water services; I was informed that pungent smells come from the old toilet's sewage waste pipe work at the rear of the stage areas; I would recommend these old toilet and outlets be removed along with all sewage waste pipe work.



EMERGENCY PROCEURES

There was seen to be no emergency procedures in place relating to an outbreak of Legionnaires Disease at the time of this risk assessment; I would recommend emergency procedures be put in place by referring to Appendix 2.3 and paragraphs 2.124–2.135 of HSG 274 part 2.

DRAWINGS

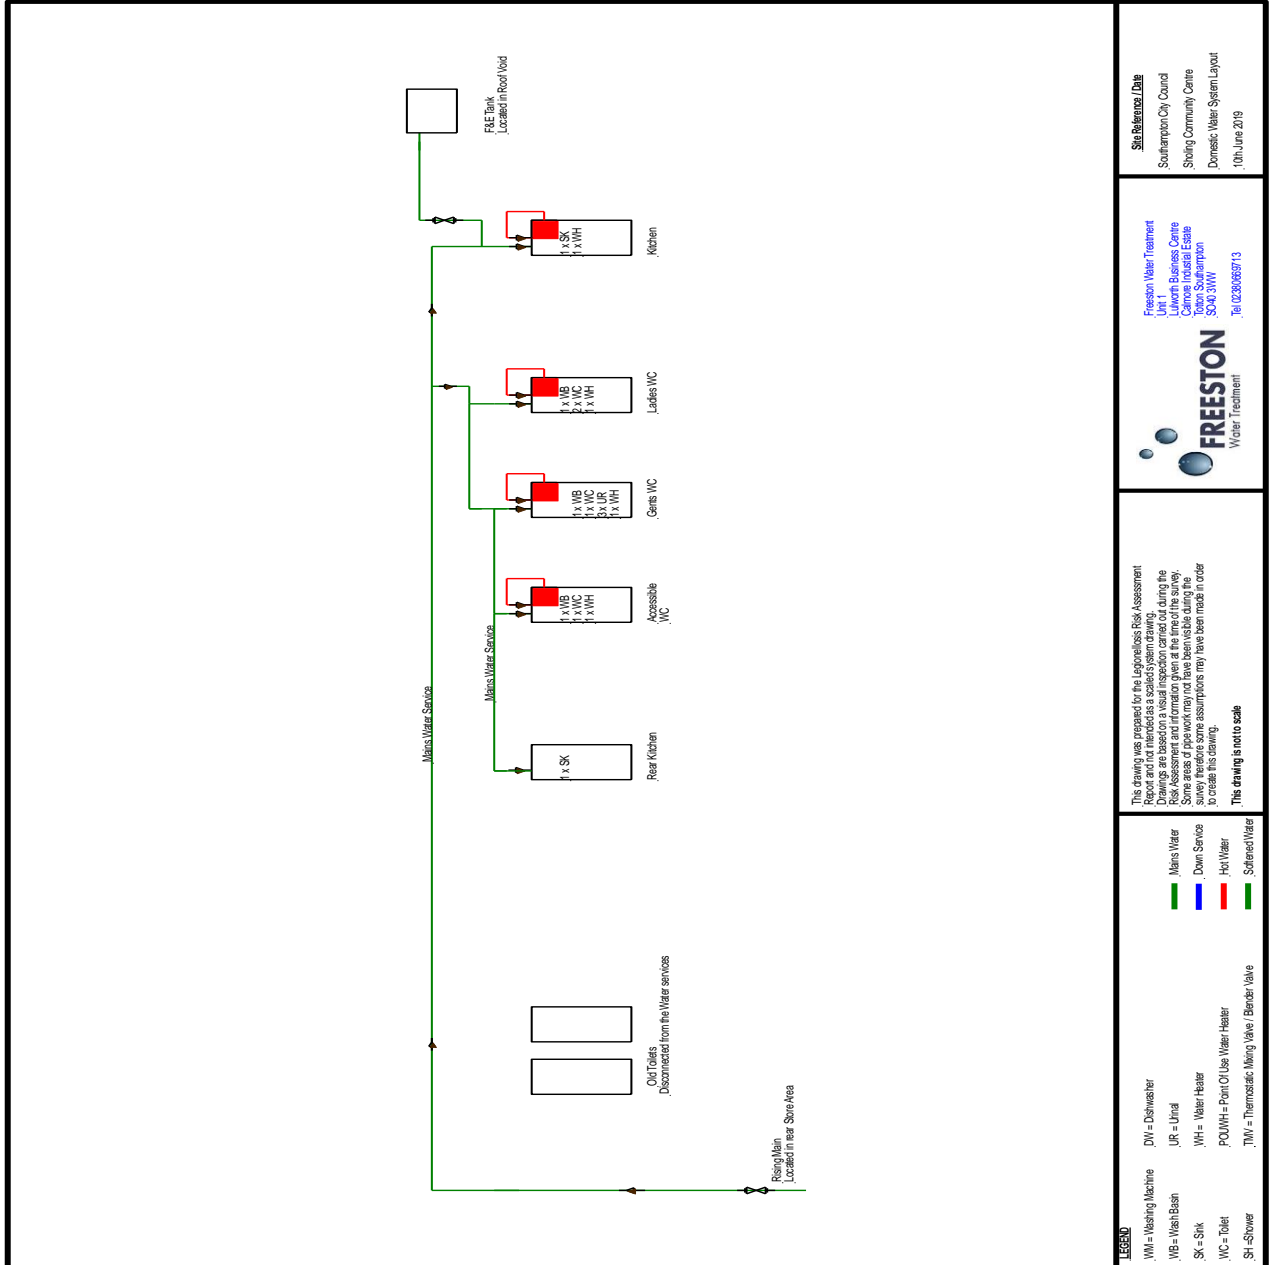

RECORDS

A water systems log book should be put in place and include records of weekly, monthly, quarterly and annual procedures. These should be carried out as recommended in this risk assessment.

Details of the responsibilities held by the Duty Holder, Responsible Person and Deputy Responsible Person should be included together with items listed as follows:

Annual internal inspections of calorifiers.

Purging of calorifiers

Audit sheet for inspections of the logbook and dated when completed.

Inspection of water storage tanks

Cleaning and disinfection of water tanks

Faults and defects to be recorded.

Flushing of all infrequently used outlets and deadlegs (weekly).

Maintenance carried out on water systems

Monthly and annual temperature monitoring

Servicing of all TMVs

Inspection and cleaning / descaling of showerheads

All of the above should be included in the water systems logbook and signed for when completed.

HSG 274 CONTROL MEASURES TABLE 2.1 (where applicable) Table 2.1: Checklist for hot and cold-water systems

Action to take		Frequency
Calorifiers	Inspect calorifier internally by removing the inspection hatch or using a boroscope and clean by draining the vessel. The frequency of inspection and cleaning should be subject to the findings and increased or decreased based on conditions recorded	Annually, or as indicated by the rate of fouling
	Where there is no inspection hatch, purge any debris in the base of the calorifier to a suitable drain Collect the initial flush from the base of hot water heaters to inspect clarity, quantity of debris, and temperature	Annually, but may be increased as indicated by the risk assessment or result of inspection findings
	Check calorifier flow temperatures (thermostat settings should modulate as close to 60 °C as practicable without going below 60 °C) Check calorifier return temperatures (not below 50 °C, in healthcare premises not below 55 °C)	Monthly
Hot water services	For non-circulating systems: take temperatures at sentinel points (nearest outlet, furthest outlet and long branches to outlets) to confirm they are at a minimum of 50 °C within one minute (55 °C in healthcare premises)	Monthly
	For circulating systems: take temperatures at return legs of principal loops (sentinel points) to confirm they are at a minimum of 50 °C (55 °C in healthcare premises). Temperature measurements may be taken on the surface of metallic pipework	Monthly
	For circulating systems: take temperatures at return legs of subordinate loops, temperature measurements can be taken on the surface of pipes, but where this is not practicable, the temperature of water from the last outlet on each loop may be measured and this should be greater than 50 °C within one minute of running (55 °C in healthcare premises). If the temperature rise is slow, it should be confirmed that the outlet is on a long leg and not that the flow and return has failed in that local area	Quarterly (ideally on a rolling monthly rota)
	All HWS systems: take temperatures at a representative selection of other points (intermediate outlets of single pipe systems and tertiary loops in circulating systems) to confirm they are at a minimum of 50 °C (55 °C in healthcare premises) to create a temperature profile of the whole system over a defined time period	Representative selection of other sentinel outlets considered on a rotational basis to ensure the whole system is reaching satisfactory temperatures for legionella control

POU water heaters (no greater than 15 litres)	Check water temperatures to confirm the heater operates at 50–60 °C (55 °C in healthcare premises) or check the installation has a high turnover	Monthly–six monthly, or as indicated by the risk assessment
Combination water heaters	Inspect the integral cold-water header tanks as part of the cold-water storage tank inspection regime, clean and disinfect as necessary. If evidence shows that the unit regularly overflows hot water into the integral cold-water header tank, instigate a temperature monitoring regime to determine the frequency and take precautionary measures as determined by the findings of this monitoring regime	Annually
	Check water temperatures at an outlet to confirm the heater operates at 55–60 °C	Monthly
Cold water tanks	Inspect cold water storage tanks and carry out remedial work where necessary	Annually
	Check the tank water temperature remote from the ball valve and the incoming mains temperature. Record the maximum temperatures of the stored and supply water recorded by fixed maximum/minimum thermometers where fitted	Annually (Summer) or as indicated by the temperature profiling
Cold water services	Check temperatures at sentinel taps (typically those nearest to and furthest from the cold tank, but may also include other key locations on long branches to zones or floor levels). These outlets should be below 20 °C within two minutes of running the cold tap. To identify any local heat gain, which might not be apparent after one minute, observe the thermometer reading during flushing	Monthly
	Take temperatures at a representative selection of other points to confirm they are below 20 °C to create a temperature profile of the whole system over a defined time period. Peak temperatures or any temperatures that are slow to fall should be an indicator of a localised problem	Representative selection of other sentinel outlets considered on a rotational basis to ensure the whole system is reaching satisfactory temperatures for legionella control
	Check thermal insulation to ensure it is intact and consider weatherproofing where components are exposed to the outdoor environment	Annually
Showers and spray taps	Dismantle, clean and descale removable parts, heads, inserts and hoses where fitted	Quarterly or as indicated by the rate of fouling or other risk factors, eg areas with high risk patients

POU filters	Record the service start date and lifespan or end date and replace filters as recommended by the manufacturer (0.2 µm membrane POU filters should be used primarily as a temporary control measure while a permanent safe engineering solution is developed, although long-term use of such filters may be needed in some healthcare situations)	According to manufacturer's guidelines
Base exchange softeners	Visually check the salt levels and top up salt, if required. Undertake a hardness check to confirm operation of the softener	Weekly, but depends on the size of the vessel and the rate of salt consumption
	Service and disinfect	Annually, or according to manufacturer's guidelines
Multiple use filters	Backwash and regenerate as specified by the manufacturer	According to manufacturer's guidelines
Infrequently used outlets	Consideration should be given to removing infrequently used showers, taps and any associated equipment that uses water. If removed, any redundant supply pipework should be cut back as far as possible to a common supply (eg to the recirculating pipework or the pipework supplying a more frequently used upstream fitting) but preferably by removing the feeding 'T' Infrequently used equipment within a water system (ie not used for a period equal to or greater than seven days) should be included on the flushing regime Flush the outlets until the temperature at the outlet stabilises and is comparable to supply water and purge to drain Regularly use the outlets to minimise the risk from microbial growth in the peripheral parts of the water system, sustain and log this procedure once started For high risk populations, eg healthcare and care homes, more frequent flushing may be required as indicated by the risk assessment	Weekly, or as indicated by the risk assessment
TMVs	Risk assess whether the TMV fitting is required, and if not, remove Where needed, inspect, clean, descale and disinfect any strainers or filters associated with TMVs To maintain protection against scald risk, TMVs require regular routine maintenance carried out by competent persons in accordance with the manufacturer's instructions. There is further information in paragraphs 2.152– 2.168	Annually or on a frequency defined by the risk assessment, taking account of any manufacturer's recommendations
Expansion vessels	Where practical, flush through and purge to drain	Monthly–six monthly, as indicated by the risk assessment

SUMMARY

At the time of this assessment there was seen to be a Southampton City Council water systems logbook in place for the buildings water systems; the logbook was seen filed in the metal cabinet in the main hall area; the duty holder, responsible person and deputies were seen recorded in section two of the logbook documentation at the time of this assessment.

Monthly Legionella control monitoring for the community centre is being carried out by contractors Freeston Water Treatment Ltd; this was seen to be up to date as of May 2019. No records were seen for weekly flushing of infrequently used outlets within the logbook documentation.

The local water heaters in the toilet areas were all switched off at the time of this assessment; I was informed these water heaters are not being used thus creating deadleg areas. If the water heaters are not required then consideration should be given into their removal along with all associated pipe work; if they are to remain then a flushing regime should be put in place and all water heaters should be flushed through at least on a weekly basis.

It should be ensured that any staff involved with the Legionella control for this community centre has adequate training; all training records or copies should be filed within the logbook documentation.

REMEDIAL RECOMMENDATIONS

Priority Rating	
	High priority issue - Urgent remedial action required to control a serious risk.
	Medium priority issue - Action is required in the near future to achieve compliance with ACoP L8/HSG274 standards/guidelines.
	Low priority issue - Minor action or remedial work that is beneficial, but may not be directly linked with compliance to ACoP L8/HSG274 standards/guidelines.

RECOMMENDATIONS

RECOMMENDATION					
Risk		HIGH	System	DOMESTIC WATER SYSTEMS	
Ref No	Picture No	Works	Comments:	Work Assigned To:	Date Completed
1		Continue with the legionella control procedures which are in place for the community centre and continue to monitor and record in the logbook documentation.			
2	2	If the toilet water heaters are not required then consideration should be given into their removal along with all associated pipe work; if they are to remain then a flushing regime should be put in place and all water heaters should be flushed through at least on a weekly basis.			
3	2	Ensure all water heaters operate at 50.0°C – 60.0°C when switched on; fit TMVs if deemed necessary.			
4	3-5	Remove deadleg pipe work			

RECOMMENDATION

RECOMMENDATION						
Risk		MEDIUM	System	DOMESTIC WATER SYSTEMS		
Ref No	Picture No	Works	Comments:	Work Assigned To:	Date Completed	
6	7	Ensure any infrequently used outlets within and external to the community centre are flushed through at least on a weekly basis; record when carried out in a water systems logbook.				
7		Legionella water samples should be taken if the domestic water temperatures constantly fall out of the acceptable limits within the community centre.				
8	6	Ensure all tap outlets within the community centre are kept free of scale build up as this is an ideal nutrient for bacteria proliferation; clean on a regular basis.				
9	9	Fit insulation to the mains water service pipe work to help prevent possible elevated cold-water temperatures especially in the summer months.				
10	10	Ensure access is made clear to the rising main isolating valve in the rear store room area to enable quick isolation if required.				

RECOMMENDATION

RECOMMENDATION						
Risk		MEDIUM	System	DOMESTIC WATER SYSTEMS		
Ref No	Picture No	Works		Comments:	Work Assigned To:	Date Completed
11	11	I was informed pungent smells come from the old toilet's sewage waste pipe work at the rear of the stage areas; I would recommend these old toilet and outlets be removed along with all sewage waste pipe work.				
12		It should be ensured that all staff involved with the Legionella control for this community centre has adequate training; all training records or copies should be filed within the logbook documentation.				

RECOMMENDATION

RECOMMENDATION						
Risk		MEDIUM	System	DOMESTIC WATER SYSTEMS		
Ref No	Picture No	Works		Comments:	Work Assigned To:	Date Completed
13	8	Ensure all flexible pipe work fittings within the community centre are WRAS approved as these can break down internally and are ideal areas for bacteria proliferation.				

GLOSSARY

This section contains the glossary of terms that may have been used within this documentation.

Aerosol	A suspension in a gaseous medium of solid particles, liquid particles or solid and liquid particles having a negligible falling velocity. In the context of this document, it is a suspension of particles which may contain legionella with a typical droplet size of <5 µm that can be inhaled deep into the lungs.
Algae	A small, usually aquatic, plant that requires light to grow.
Bacteria	(Singular bacterium) a microscopic, unicellular (or more rarely multicellular) organism.
Biocide	Substance which kills microorganisms.
Biofilm	A community of bacteria and other microorganisms embedded in a protective layer with entrained debris, attached to a surface.
Calorifier	An apparatus used for the transfer of heat to water in a vessel, the source of heat being contained within a pipe or coil immersed in the water
Chlorine	An element used as a biocide and for disinfection
Chlorine dioxide	A compound used as a biocide.
Cold water service	Installation of plant, pipes and fitting in which cold water is stored, distributed and subsequently discharged.
Contact time	The time a chemical is retained in the system.

Corrosion inhibitors	Chemicals which protect metals by: passivating the metal by the promotion of a thin metal oxide film (anodic inhibitors); or physically forming a thin barrier film by controlled deposition (cathodic inhibitors).
Dead end/blind end	A length of pipe closed at one end through which no water passes.
Dead leg	A length of water system pipework leading to a fitting through which water only passes infrequently when there is draw off from the fitting, providing the potential for stagnation.
Disinfection	The reduction of the number of microorganisms to safe levels by either chemical or non-chemical means (eg biocides, heat or radiation).
Distribution circuit	Pipework which distributes water from hot or cold-water plant to one or more fittings/appliances.
Domestic water	Hot and cold water intended for drinking, washing, cooking, food preparation or other domestic purposes.
Fouling	Organic growth or other deposits on heat transfer surfaces causing loss in efficiency.
Hot water service	Installation of plant, pipes and fittings in which water is heated, distributed and subsequently discharged (not including cold water feed tank or cistern).
Legionnaires' disease	A form of pneumonia caused by bacteria of the genus legionella.
Legionella (plural legionellae)	A bacterium (or bacteria) of the genus legionella.
Legionellosis	Any illness caused by exposure to legionella.
Microorganism	An organism of microscopic size, including bacteria, fungi and viruses.

Neonates	Newborn children.
Nutrient	A food source for microorganisms.
Pasteurisation	Heat treatment to destroy microorganisms, usually at high temperature.
pH	The logarithm of the reciprocal of the hydrogen ion concentration in water, expressed as a number between 0 and 14 to indicate how acidic or alkaline the water is. Values below 7 are increasingly acidic, 7 is neutral, and values higher than 7 are progressively alkaline. However, acidity and alkalinity are not proportional to pH.
Planktonic	Free-floating microorganisms in an aquatic system.
Point of use (POU) filters	A filter with a maximal pore size of 0.2 µm applied at the outlet, which removes bacteria from the water flow.
Ppm	Parts per million) a measure of dissolved substances given as the number of parts there are in a million parts of solvent. It is numerically equivalent to milligrams per litre (mg/l) with respect to water.
Risk assessment	Identifying and assessing the risk from legionellosis from work activities and water sources on premises and determining any necessary precautionary measures.
Scale inhibitors	Chemicals used to control scale. They function by holding up the precipitation process and/or distorting the crystal shape, thus preventing the build-up of a hard adherent scale.
Sentinel taps	For hot water services – the first and last taps on a recirculating system. For cold water systems (or non-recirculating HWS), the nearest and furthest taps from the storage tank. The choice of sentinel taps may also include other taps which represent parts of the recirculating system where monitoring can aid control

Sero-group	A sub-group of the main species.
Sessile	Aquatic microorganisms adhering to a surface, normally as part of a biofilm.
Shunt pump	A circulation pump fitted to hot water service/plant to overcome the temperature stratification of the stored water.
Slime	A mucus-like exudate that covers a surface produced by some microorganisms.
Sludge	A general term for soft mud-like deposits found on heat transfer surfaces or other important sections of a cooling system. Also found at the base of calorifiers and cold-water storage tanks.
Stagnation	The condition where water ceases to flow and is therefore liable to microbiological growth.
Strainers	Coarse filters usually positioned upstream of a sensitive component, such as a pump control valve or heat exchanger, to protect it from debris.
Thermal disinfection	Heat treatment to disinfect a system.
Thermostatic mixing valve	A mixing valve in which the temperature at the outlet is pre-selected and controlled automatically by the valve.
Total viable counts (TVC)	The total number of culturable bacteria (per volume or area) in a given sample (does not include legionella).
Wholesome water	Water supplied for such domestic purposes as cooking, drinking, food preparation or washing; or supplied to premises in which food is produced

If any further information is required, please feel free to contact Freeston Water Treatment Ltd, or the surveyor responsible for the works on your site.

Signed:

Peter Smith

Risk Assessor MWM Soc

Freeston Water Treatment Ltd

TERMS AND CONDITIONS

This assessment is based on information known to Freeston Water Treatment Ltd on the date of survey. Freeston Water Treatment Ltd accepts no responsibility for any loss or claim arising from information contained within this or any other associated document; “All our Risk Assessors are fully trained and competent to carry out Legionella Risk Assessments”.

Freeston Water Treatment Ltd reserve the right to allow our client fourteen days in which to notify Freeston Water Treatment Ltd of any inaccuracies contained within this documentation or changes that should be made, after which it will be assumed that our client has accepted the documentation to be satisfactory and fully complete.

Freeston Water Treatment Ltd rights reserved. No part of the format and content of this documentation may be reproduced, stored in a retrieval system or transmitted, in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without the prior written permission of Freeston Water Treatment Ltd.

In accordance with ACoP L8 (2013), Paragraph 47 – The Risk Assessment must be reviewed regularly and/or whenever there is reason to believe that the original assessment may no longer be valid.

We cannot guarantee that all pipework passing underground or through floors, walls and ceilings has been traced, and it is possible that certain system dead-ends or deadlegs may not have been identified. As a result, any schematic diagram(s) contained within this report only detail the visible or assumed pipework.

Whilst every effort has been made to ensure the accuracy of the content of this document, Freeston Water Treatment Limited will accept no responsibility for any omissions.

LEGISLATION

Health and Safety at Work etc. Act 1974

This Act is concerned with health, safety and welfare in connection with work and those people who may be affected by it. The act is primary legislation under which the Secretary of State makes specific regulations affecting the control of Legionellosis.

Management of Health and Safety at Work Regulations 1999

The regulations provide a framework for managing health and safety at work including the requirement for risk assessments and the establishment of appropriate management systems and procedures.

Control of Substances Hazardous to Health Regulations 2002 (as amended)

The aim of the Control of Substances Hazardous to Health (COSHH) Regulations 2002 is to protect persons who may be affected by hazardous substances present in the workplace. This includes both chemical and biological agents. The employer has to assess the risk from such substances, and for certain substances he has to measure the employees' exposure to them.

Reporting of Injuries, Diseases and Dangerous Occurrences Regulations 2013 (RIDDOR)

While Legionnaires' disease as such is not a notifiable disease under public health legislation (except in Scotland), it is reportable under RIDDOR if it could have been contracted in the workplace.

Notification of Cooling Towers and Evaporative Condensers Regulations 1992

These regulations require all premises containing a cooling tower or evaporative condenser to notify the local authority in whose area the building is situated. A form is available from the Environmental Health Department of the local authority. Notification must also be given of changes to the information supplied. It is however inspectors of the Health and Safety Executive who police the safe operation of cooling towers.

Water Supply (Water Fittings) Regulations 1999

These regulations are not directly concerned with the Legionellosis hazard, but govern the design, construction and use of materials in water systems. In particular they cover: -

- Backflow protection, i.e. the use of air gaps and not-return valves to protect the supply.
- The maintenance of water quality, e.g. tank design for hot and cold-water services.
- The use of materials, i.e. those that do not promote bacterial growth.
- Water conservation, i.e. prevention of leakage.